



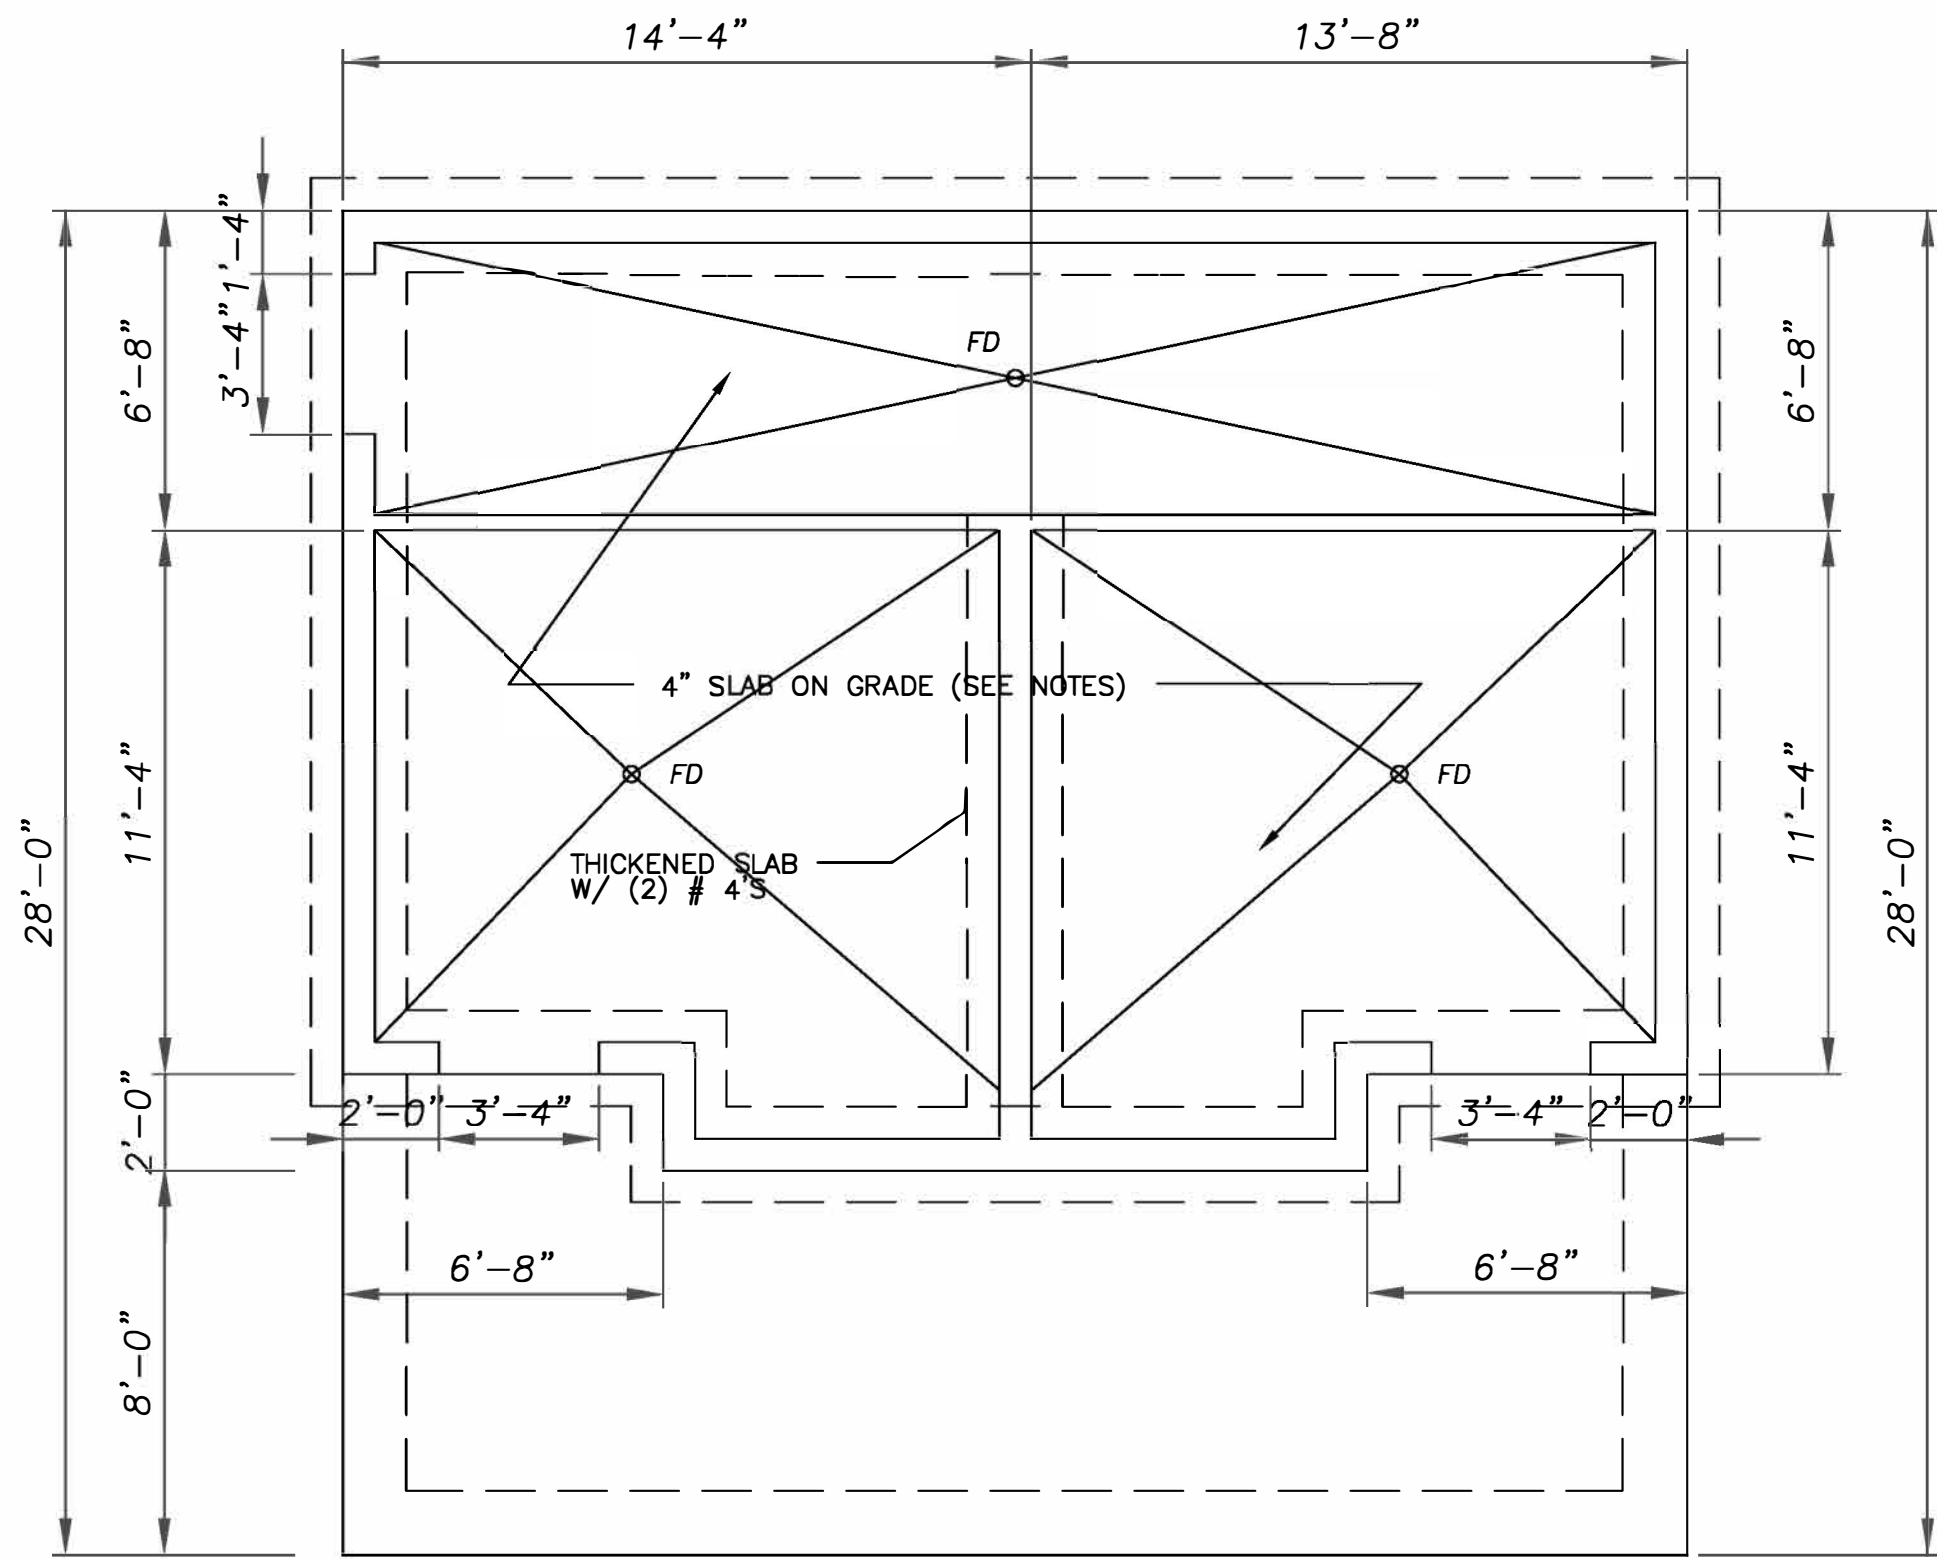

1 FOUNDATION PLAN
A1.1 SCALE: 1/4" = 1'-0"

- NOTES:
1. SOIL BEARING CAPACITY 2,000 P.S.F. MINIMUM OR 95 % STANDARD PROCTOR (FIELD VERIFY).
 2. CONCRETE IS 3,000 P.S.I. MIX.
 3. CONCRETE DESIGN PER ACI 318.
 4. PROVIDE (6) MIL POLY VAPOR BARRIER UNDER SLAB.
 5. PROVIDE 6 x 6 10/10 WELDED WIRE FABRIC IN MIDDLE OF SLAB.
 6. TURNED DOWN FOOTING IS 18" x 18" CONTINUOUS W/ (2) #4 BARS CONTINUOUS.
 7. MINIMUM BAR SPLICE IS 1'-0".
 8. PROVIDE 1/4" W X 1" DEEP SAWED CONTROL JOINTS AT 400 S.F. INTERVALS

→ ATTENTION:
FIELD VERIFY SATISFACTORY BEARING
CONDITIONS FOR NEW CONSTRUCTION BY
GEOTECHNICAL ENGINEER (SEE NOTES).

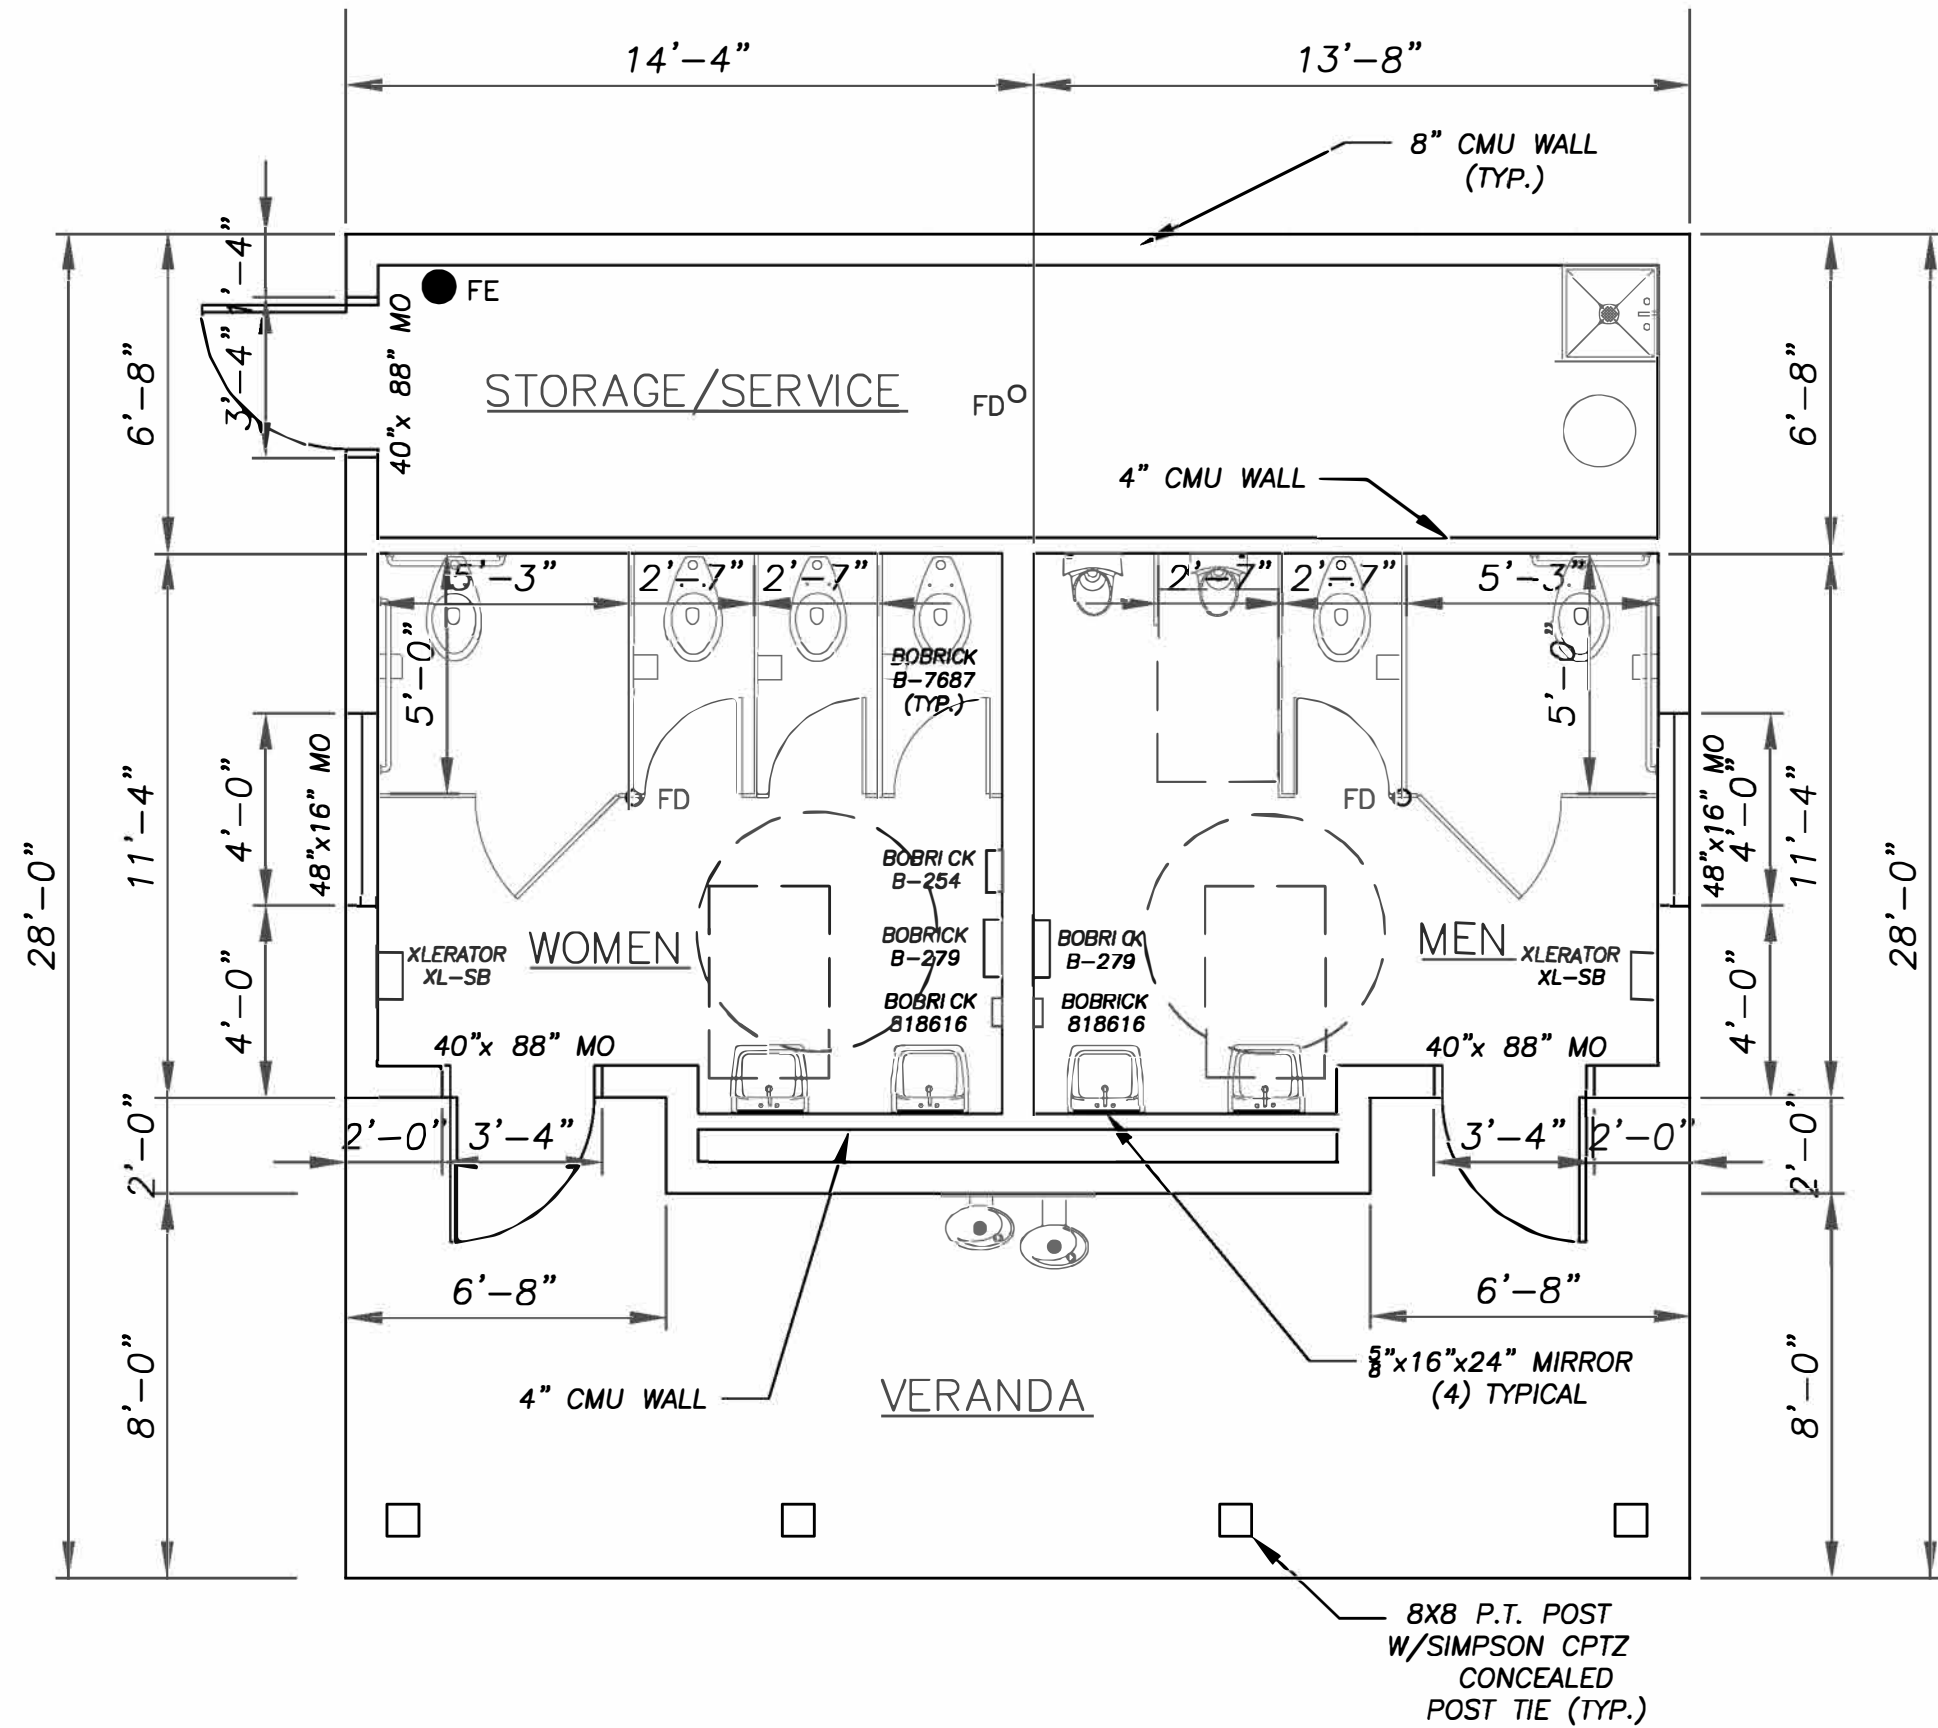

2 FLOOR PLAN
A1.1 SCALE: 1/4" = 1'-0"

● FE DENOTES PORTABLE FIRE EXTINGUISHER PER NFPA 10. LOCATIONS PER FIRE DEPT.

ALL DOORS INSULATED METAL IN HOLLOW CORE METAL FRAMES

DOOR HARDWARE SCHEDULE:
PER DOOR--ALL DOORS EQUAL

DEADBOLT	SCHLAGE JD60 630
CLOSER	LCN--P4040XP
PUSH	ROCKWOOD 70C.32D
PULL	ROCKWOOD 132 X 70C.32D
(3)HINGES	PHG--CH401
T/H	PEMCO 2748 (A) MILL FINISH
WEATHERSTRIPPING	PEMCO 2891




REVISIONS

#	DATE

RESTROOMS
AT:

ANDREWS
PARK

501
WELLINGTON
STREET
MADISON,
GEORGIA

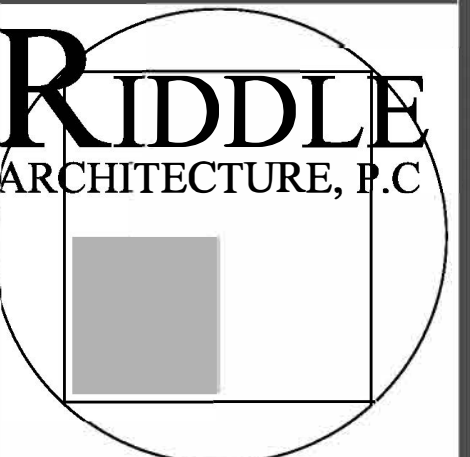

1481 HODGES MILL ROAD
WATKINSVILLE, GA
30677
(404) 285-8646

TITLE: PLANS

JOB #: 2513

DATE: 02.04.26

SHEET #

A-1.1